


MEDIUM VOLTAGE AMP TRAP FUSE
CAT. NO. A072B3DBR0-48X
A072B3DBR0-57X
48X - 57X 7.2kV
TOTAL CLEARING TIME - CURRENT CURVE
FERRAZ SHAWMUT
NEWBURYPORT, MA 01950

720657

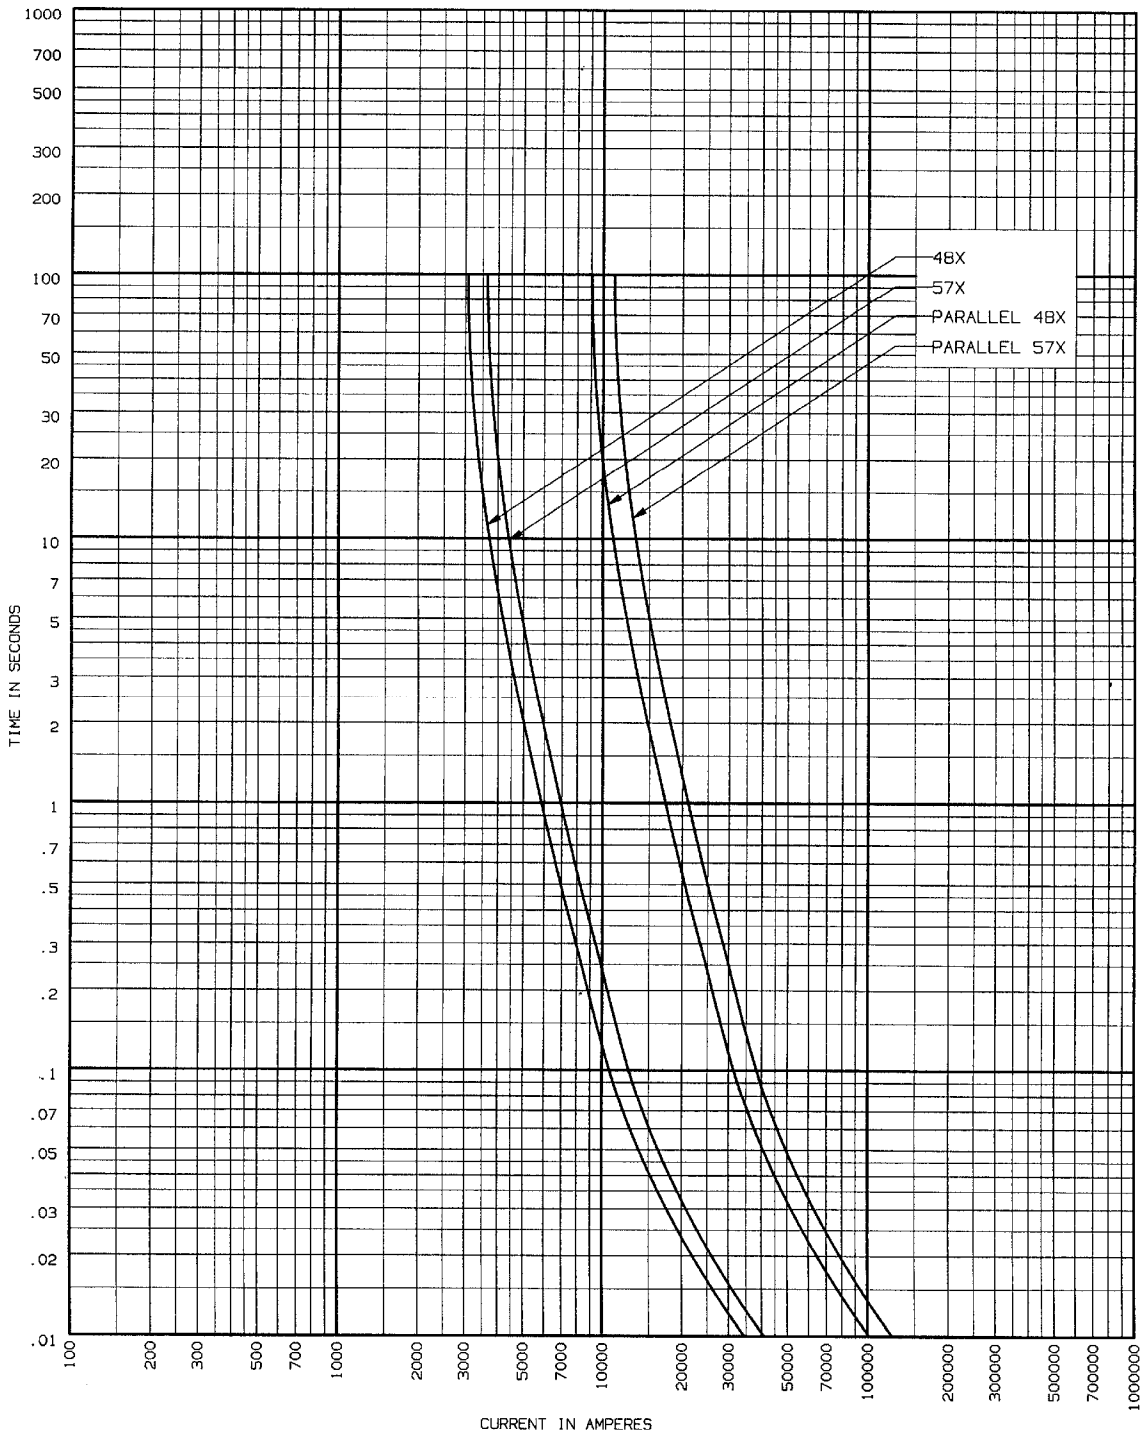

CONTROL NO.: 733
REV.: -
FOLDER NO.: SE
2/10/05